# △ OCV Model 77 DE\HM △ Aquestia

Deluge Valves



#### Hydraulically Actuated Deluge Valve

#### Description

Hydraulically controlled deluge/pre-action valve, actuated by the pipeline pressure. The valve is closed in its normal, set position and opens when the hydraulic pressure drops in a pressurized pilot line, limited to 7m above the valve (for higher pilot lines, see OCV DE\ HRV model sheet). An emergency manual release valve is fitted as standard. Also available with manual reset: DE\HM-MR.

## Certification & Compliance

Lloyd's Register Approval

ANSI FCI 70-2 Class VI seat leakage class

#### Features & Benefits

- High pressure, high flow deluge systems
- Automatic or local manual emergency actuation
- Hazardous, flammable & explosion classified area fire suppression
- Superior design featuring exceptionally low pressure losses at high flow rates
- Low lifelong maintenance costs due to straightforward design
- Applicable for fresh or brackish water, seawater & foam
- Out of box fully assembled & tested valves
- Factory trimmed for vertical & horizontal installations without modification
- Extensive valve & trim materials selection and corrosion protection coating



Automatic or Manual Actuated Fire Suppression Systems

Petrochemical, Oil & Gas Installations

Tunnels

Power Generation, Transformer & Transmission Plants



Lloyd's

Flammable Storage

Hangers & Airport Terminals

Onshore/Offshore

Mining



# **COCV** Model 77 DE\HM **Aquestia**


## > Operation

The basic control valve [1] used in this deluge system is a direct sealing elastomeric diaphragm, hydraulically operated control valve engineered specifically for fire protection systems.


In the standby position, the deluge value is held closed by the upstream water pressure, trapped in the value's control chamber. The water pressure enters the control chamber through the priming line ball value [2], a Y-Type strainer [3], a check value [4] and a T-restrictor [5].


Under fire conditions, one (or more) of the automatic sprinklers on the wet pilot line burst. Water is drained from the deluge valve's control chamber through the burst sprinklers. The deluge valve opens instantly and allows water to flow into the pipeline and through the open sprinklers over the protected area.

Manual emergency actuation is enabled by opening the emergency manual activation valve [6]. The deluge valve opens instantly and allows water to flow into the pipeline and through the open sprinklers over the protected area.

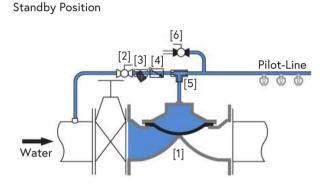

Electrically Actuated

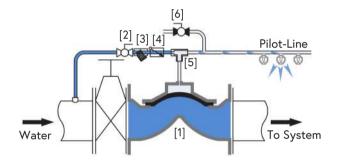

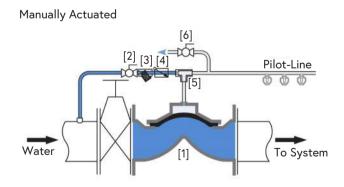


Resetting, maintenance, and periodic testing instructions must be followed as described in detail in the applicable OCV IOM (Installation, Operation & Maintenance) Manual.



#### > Typical Installation

The typical installation of the OCV 77 DE\HM is as shown:

- 1 Hydraulically Actuated Deluge Valve
- 2 Wet Pilot Line

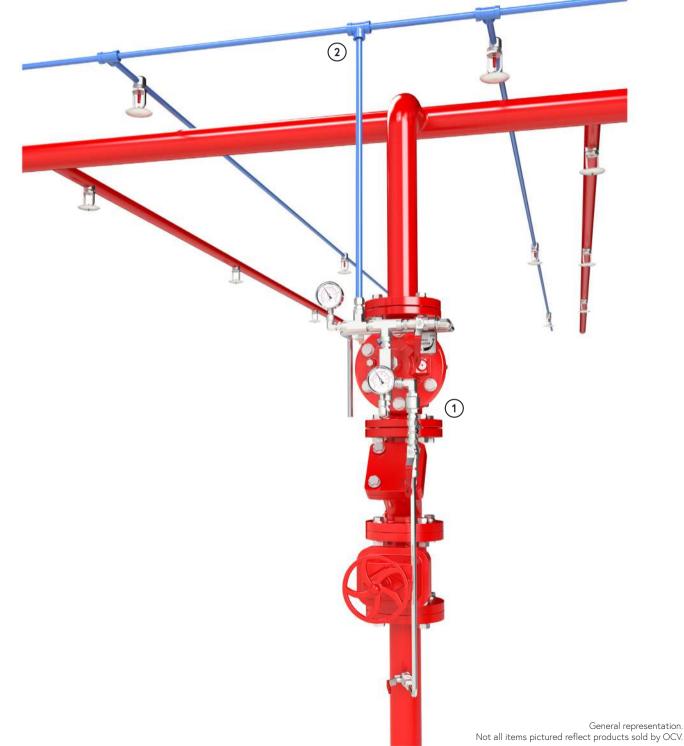

# △ OCV Model 77 DE\HM △ Aquestia



Deluge Valves

#### **Technical Data**

Temperature (Elastomers)		
Media	up to 80°C = 176°F	
Elastomers	suitable for extreme climates (available upon request)	
Sizes		
Lloyd's Type Approved	2" - 24"	
Pressure Rating (ANSI at 100°F)		
230psi / 16 bars		
End Connections		
Flanged	ISO-PN16	
	ANSI B16.42 & B16.5 Class 150#	
	Additional options available upon request	
Grooved	Sizes: 2"-6"	

Body & Cover Material		
Ductile Iron	Stainless Steel	
Cast Steel	NAB	
Trim Material		
Bronze/Brass - Copper		
Stainless Steel		
Monel		
Optional Components		
Position Indicator		
Alarm Test Trim		
Upstream Drain Valve		
Pressure Switch		
Limit/Proximity Switch		
Items to Specify		
Electrical features other than standard (24VDC, IP65/NEMA4)		
If explosion proof accessories are required such as solenoids, pressure switches, etc., please define classification		
Control trim material other than standard		
Required standards, certifications and approvals		

## Engineering Specifications

The deluge valve shall be hydraulically operated, direct elastomeric diaphragm-seal, single chamber weir type. The valve shall consist of three major components: the body, the cover and the diaphragm assembly. The diaphragm assembly shall be the only moving part. The diaphragm forms a sealed control chamber in the upper portion of the valve, separating operating pressure from line pressure. Packing glands, stuffing boxes and dynamic o-ring seals are not permitted and there shall not be shafts, discs, bearings or pistons operating the valve. No hourglass shaped disc retainers shall be permitted, and no V-type, U-type or other slotted type disc guides shall be used. The valve shall contain a nylon reinforced rubber diaphragm, elastic & resilient through its entire surface without vulcanized radial seals and/or reinforcements. The diaphragm assembly shall not be guided by any shafts or bearings and shall not be in close contact with other valve parts except for its sealing surface. The deluge valve shall be fully trimmed, hydrostatically and operationally tested at the factory. Maintenance, disassembly and reassembly of all the valve's components shall be made possible on-site and in-line, without the need to remove the valve from the line. Main valve body and bonnet standard material shall be ductile iron or cast steel. Main valve body and bonnet surfaces shall include a fire red epoxy coating. Other materials and coatings available upon request. The deluge valve shall be a OCV 77 DE\HM, Lloyd's Type Approved, as manufactured by OCV, an Aquestia Ltd. brand, Tulsa, OK, USA.

Aquestia Ltd. reserves the right to make product changes without prior notice. To ensure receiving updated information on parts specifications, please contact us at usa@aquestia.com. Aquestia Ltd. shall not be held liable for any errors. All rights reserved

